

# WEP Lupe Wall



**WARNING – PLEASE READ ALL INSTRUCTIONS PRIOR TO INSTALLATION  
 READ AND FOLLOW ALL WARNINGS AND INSTRUCTIONS BEFORE INSTALLING OR MAINTAINING THIS PRODUCT.  
 TURN OFF POWER PRIOR TO ANY WORK ON THE SYSTEM OR PRODUCT.  
 DO NOT INSTALL DAMAGED PRODUCT.  
 AMBIENT TEMPERATURE AT LUMINAIRE LOCATION SHOULD NOT EXCEED 40°C DURING NORMAL OPERATION.**

Installing, wiring, and maintenance must be done by qualified persons or a certified electrician in accordance with all local and National Electrical Codes.

Warranty is voided in case of unauthorized modifications and/or improper use.

Save these instructions. Use as reference when service or maintenance is performed.


Refer to product label for voltage requirements and properly ground fixture in accordance with all local and national electrical codes.

If building and product supports optional dimming, connect dimming leads to dimming control system (provided by others). Refer to product label for dimming requirements. Isolate dimming wires individually if not in use.

Always turn off main power before installation.

**NOTE:** Must use 1½" or 2½" octagonal 4 in. junction box, suggested for LLED version.

## DIMENSIONS

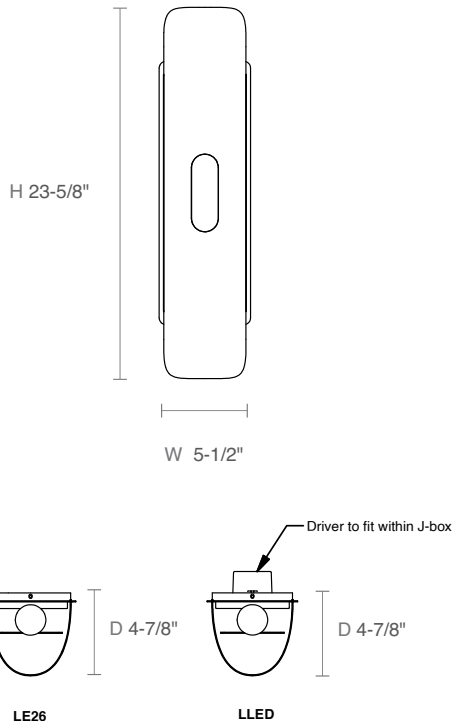

### ⚠ WARNING ⚠

- To avoid possible electrical shock, before installing light fixtures, disconnect power by turning off the circuit breakers both to the outlet box and to its associated wall switch location. If you cannot lock the circuit breakers in the off position, securely fasten a prominent warning device, such as a tag, to the service panel.
- Verify that supply voltage is correct by comparing it with the luminaire label information.
- Make all electrical and ground connections in the accordance with the National Electrical Code (NEC) and any applicable local code requirements.
- Wait for fixture and driver to cool before servicing and performing maintenance.

### ⚠ CAUTION ⚠

- All wiring must comply with national and local electrical codes and ANSI/NFPA 70. If you are unfamiliar with wiring, consult a qualified electrician.
- PPE Personal Protective Equipment such as gloves and safety glasses should always be used when installing, maintaining or servicing.
- Risk of fire. Keep combustible material away from fixtures.

### ⚠ ADVERTENCIA ⚠

- Para evitar un choque eléctrico, antes de instalar luminarias, desconecte la alimentación apagando los interruptores de circuito en el panel de servicio y en las paredes. Si no es posible bloquear los interruptores en la posición de apagado, sujete una etiqueta de seguridad en el panel de servicio.
- Compruebe que la tensión de alimentación es correcta comparándola con la información en la etiqueta de la luminaria.
- Haga todas las conexiones eléctricas y puesta a tierra de acuerdo con el código eléctrico nacional (NEC) y los requisitos del código local aplicable.
- Espere hasta que la luminaria y el controlador se enfríen antes de empezar el servicio y mantenimiento.

### ⚠ PRECAUCION ⚠

- Todo el cableado debe cumplir con los códigos eléctricos nacionales y locales y ANSI/NFPA 70. Si no está familiarizado con el cableado, consulte a un electricista.
- Al instalar, mantener o reparar, siempre se debe utilizar equipo de protección personal como guantes y lentes de seguridad
- Riesgo de incendio. Mantenga los materiales combustibles lejos de las luminarias.

### ⚠ AVERTISSEMENT ⚠

- Pour éviter les chocs, avant d'installer des appareils d'éclairage, coupez l'alimentation en désactivant les disjoncteurs et l'emplacement du commutateur mural. Si vous ne pouvez pas verrouiller les disjoncteurs en position d'arrêt, fixer un avertissement sur le panneau de service.
- Vérifiez que la tension d'alimentation est correcte en le comparant avec les informations d'étiquette de luminaire.
- Effectuer tous les raccordements électriques et mise à la terre dans la conformité avec le Code électrique National (NEC) et des exigences du code local applicable.
- Laisser suffisamment de temps pour l'appareil et pilote refroidir avant d'effectuer l'entretien et la maintenance.

### ⚠ MIS EN GARDE ⚠

- Tout le câblage doit être effectué conformément aux codes électriques locaux et nationaux et ANSI/NFPA 70. Si vous êtes peu familier avec câblage, vous devez utiliser un électricien qualifié.
- Équipement de protection personnelle comme des gants et des lunettes de sécurité doivent être utilisés en tout temps lors de l'installation, maintenance ou entretien.
- Risque d'incendie. Garder les matières combustibles loin de luminaires.

## INSTRUCTIONS FOR USE

De-energize circuit before installation.

**NOTE:** Must use 1½" or 2⅝" octagonal 4 in. junction box, suggested for LLED version.

### LE26: Follow Step 1A - 2A:

#### STEP 1A - MOUNTING BRACKET:

Locate wires from fixture. Remove the canopy screws using a screwdriver, allowing mounting bracket to detach from canopy. Once mounting bracket is separated from canopy, fasten mounting bracket to the junction box (Fig.1a).



Fig.1a: Wiring for junction box to fixture.

### LLED: Follow Step 1B - 2B:

#### STEP 2A - MOUNTING BRACKET:

Locate wires from fixture and driver. Remove the canopy screws using a screwdriver, allowing mounting bracket to detach from canopy. Once mounting bracket is separated from canopy, fasten mounting bracket to the junction box (Fig.2a).



Fig.1b: Wiring for junction box to fixture.

#### STEP 2A - WIRING FIXTURE TO JUNCTION BOX:

Connect live, neutral and ground wires from junction box to designated wago's labeled on canopy (Fig.2a).

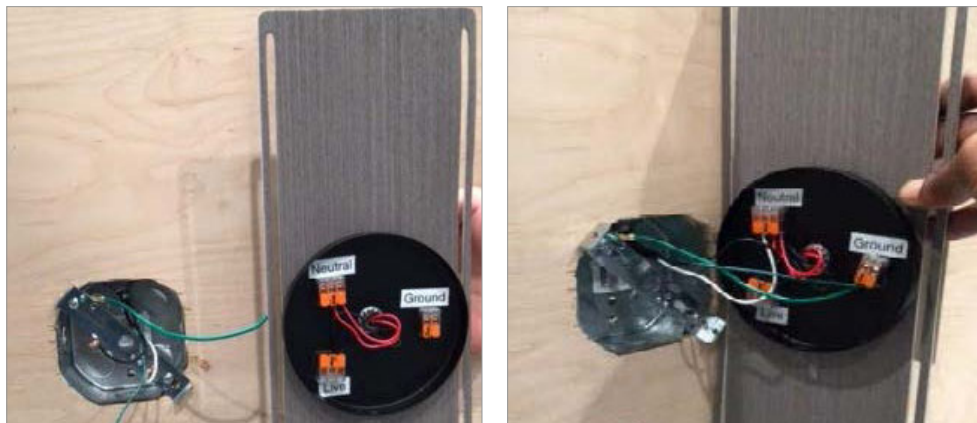


Fig.2a: Separate mounting bracket from canopy by removing set screws.

#### STEP 2A - WIRING FIXTURE TO JUNCTION BOX:

Use (2) wire nuts to connect neutral and live wires from driver and junction box. Connect Led (-), identified by blue colored wire, and Led (+), identified by red colored wire, from driver to designated wago's labeled on canopy. Connect grounds, identified by green wires, from junction box and mounting plate to designated wago's. Wire Dim wires together. If DIM is not necessary, crimp wires (Fig.2b).

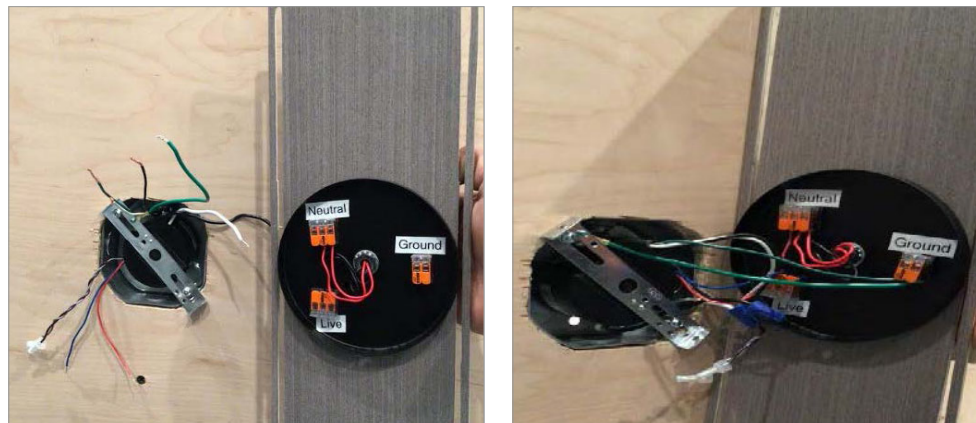


Fig.2b: Separate mounting bracket from canopy by removing set screws.

## INSTRUCTIONS FOR USE

De-energize circuit before installation.

**NOTE:** Must use 1½" or 2⅞" octagonal 4 in. junction box, suggested for LLED version.

### LE26 and LLED: Follow Step 3 - 5:

#### STEP 3 - SECURE CANOPY:

Use a screwdriver driver and canopy screws to secure canopy to the mounting bracket (Fig.3).



Fig.3: Secure canopy to mounting brackets using canopy screw.

#### STEP 5 - ATTACH SHADE COVER

Attach shade cover by placing it over the back cover, allowing tabs to slide inside of back cover slots (Fig.5).



Fig.5: Slide shade cover into back cover slots to secure shade cover to fixture.

#### STEP 4 - ADJUST FIXTURE:

Fixture may be tilted when mounted. Rotate the fixture to desired position. Adjust fixture using nuts located in the light assembly. Ensure that the fixture is flush to the mounting surface. Obtain shade cover (Fig.4).

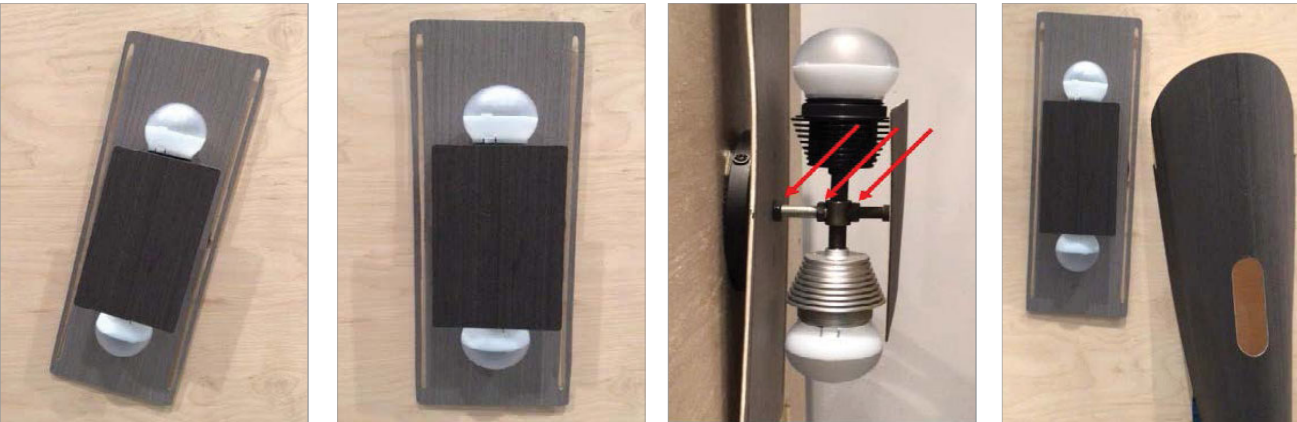


Fig.4: Adjust fixture and secure when leveled. Obtain shade cover.